


SIX WIRE TOTALIZED METERING

KW AND KVA - FOR USE WITH CURRENT TRANSFORMERS

4.06.5

M680DM

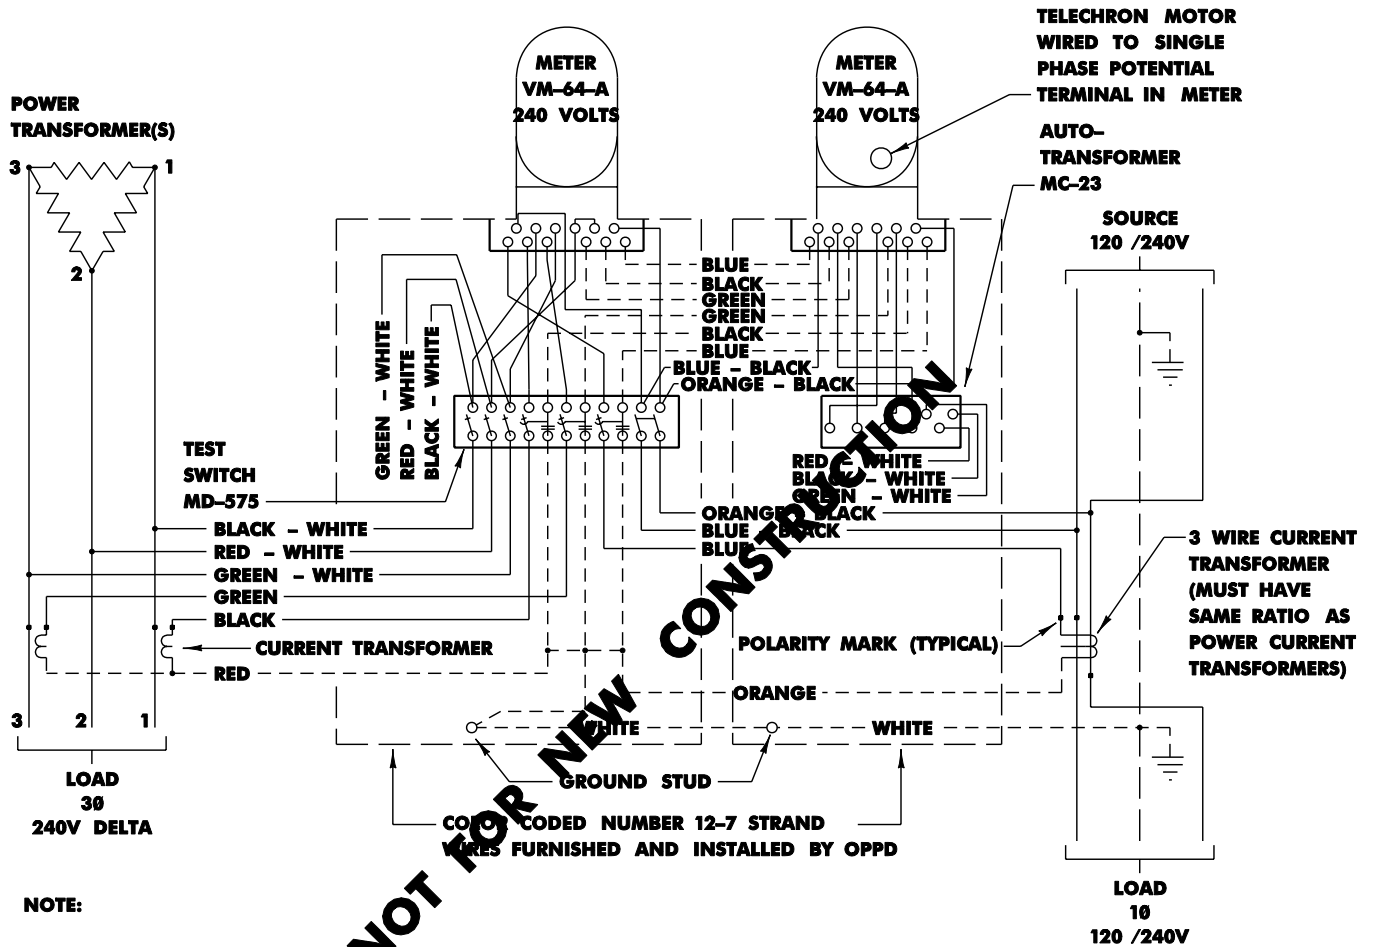

NOTE:

PHASE ROTATION ON POTENTIAL AT THE METER MUST BE 1 - 2 - 3 BY TEST

NOT FOR NEW CONSTRUCTION

NOTES:

CUSTOMER TO FURNISH AND INSTALL "NATIONAL ELECTRICAL CODE" GRADE STEEL CABINET OF ADEQUATE SIZE FOR THE CURRENT TRANSFORMERS AND ALL WIRING CONNECTIONS.

SERVICE ENTRANCE NEUTRAL MUST BE BONDED TO CURRENT TRANSFORMER CABINET.

CUSTOMER TO FURNISH AND INSTALL 1 1/4" CONDUIT FROM CURRENT TRANSFORMER CABINET TO METER CABINET.

FOR LUG CONNECTIONS ON CURRENT TRANSFORMERS UP TO 600 AMPERES MINIMUM BOLT SIZE 3/8" OVER 600 AMPERES MINIMUM BOLT SIZE 1/2".

