


# 1Ø PADMOUNT TRANSFORMER SLAB DETAIL

CONVENTIONAL, 250KVA AND 333KVA  
MAX. WEIGHT 3000 POUNDS

8.08.3

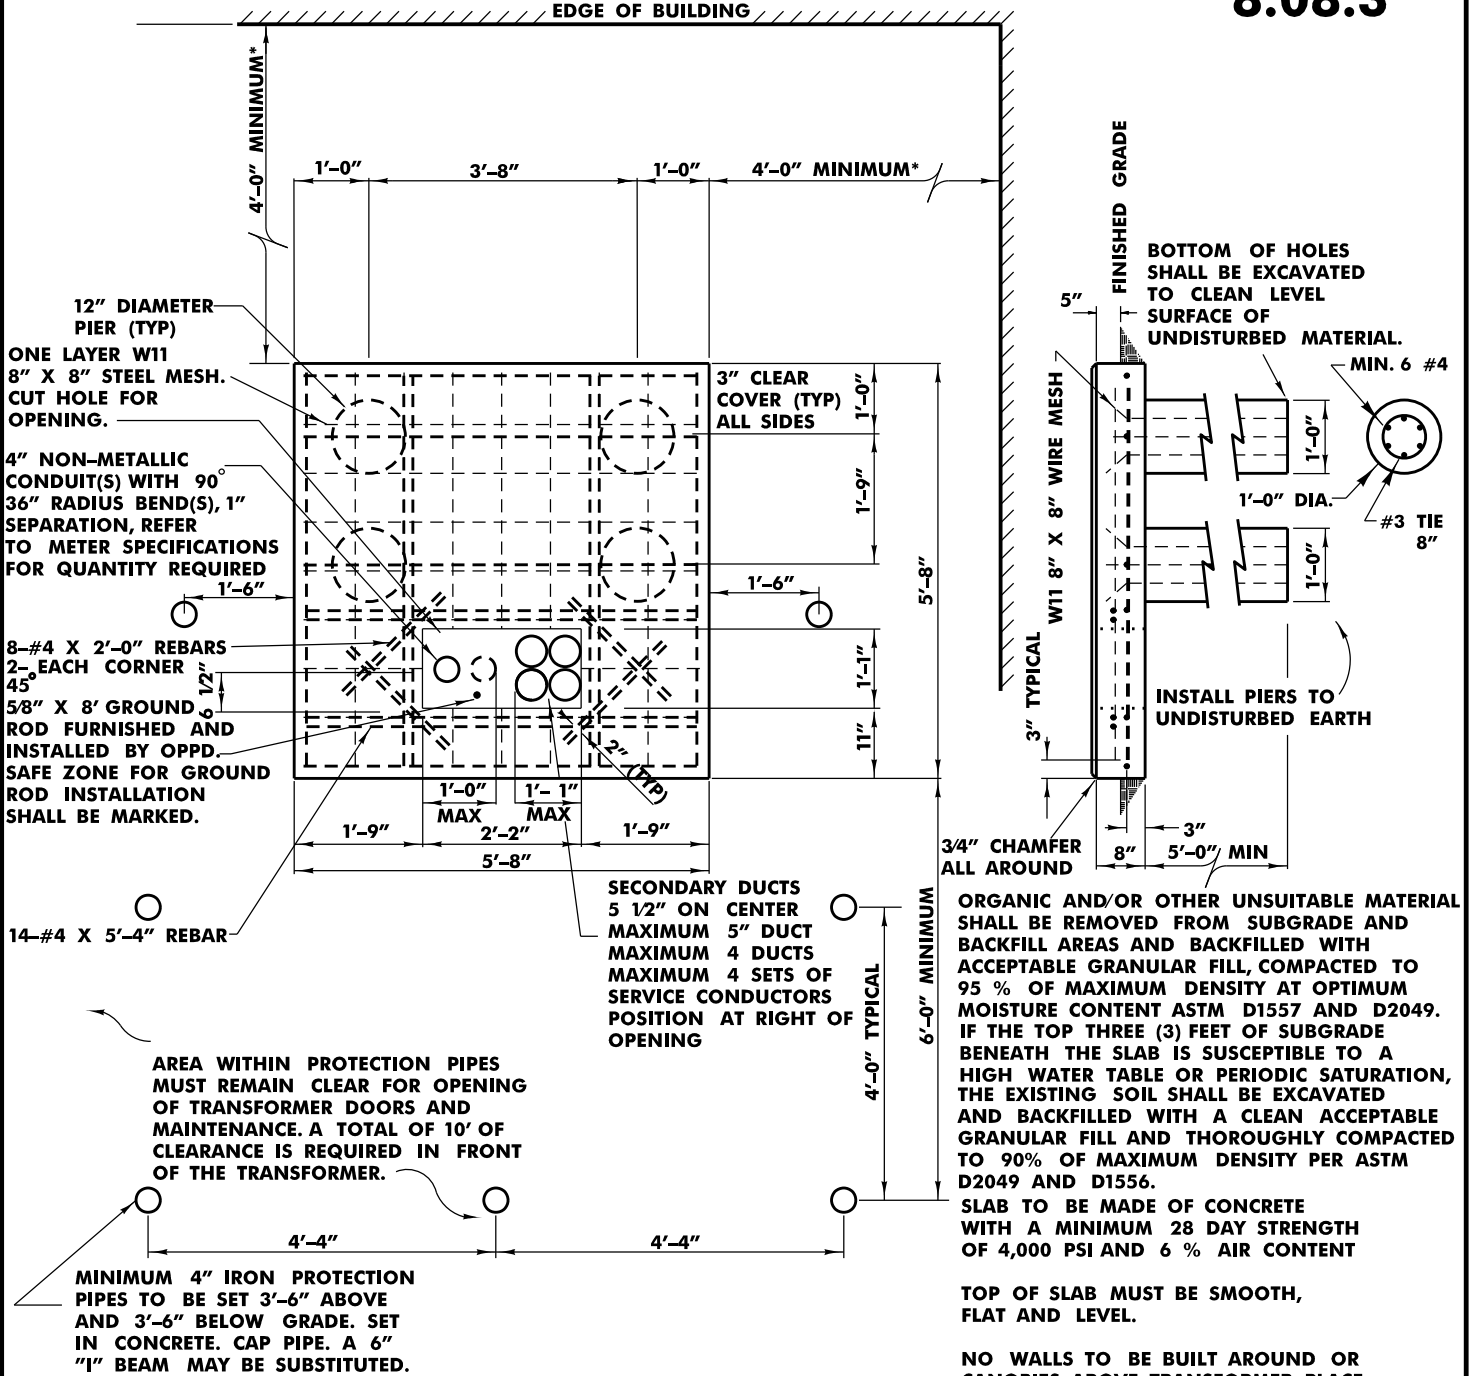

AREA WITHIN PROTECTION PIPES MUST REMAIN CLEAR FOR OPENING OF TRANSFORMER DOORS AND MAINTENANCE. A TOTAL OF 10' OF CLEARANCE IS REQUIRED IN FRONT OF THE TRANSFORMER.

MINIMUM 4" IRON PROTECTION PIPES TO BE SET 3'-6" ABOVE AND 3'-6" BELOW GRADE. SET IN CONCRETE. CAP PIPE. A 6" "I" BEAM MAY BE SUBSTITUTED.

COORDINATE WITH OPD TO INSPECT SITE PRIOR TO POURING CONCRETE. INSPECTION WILL INCLUDE LOCATION AND DEPTH OF HOLES FOR SUPPORT PIERS, AND CONDUIT PLACEMENT. OPD INSPECTION DOES NOT INCLUDE INSPECTING FOR INSURANCE RECOMMENDED BUILDING CLEARANCES.

\* THIS DRAWING SHOWS THE MINIMUM CLEARANCE NEEDED FOR PHYSICAL REASONS; FACTORY MUTUAL INSURANCE COMPANY RECOMMENDS THE FOLLOWING SEPARATION DISTANCES BETWEEN THE SPECIFIED TYPE OF BUILDING AND TRANSFORMER FOR MINERAL-OIL FILLED TRANSFORMERS WITH UNDER 500 GALLONS OF OIL. BUILDING OWNERS AND THEIR CONTRACTORS ARE RESPONSIBLE FOR LOCATING THE SLAB PER OPD MINIMUM CLEARANCE GUIDELINES AND THEIR INSURANCE COMPANY RECOMMENDATIONS.

TWO HOURS FIRE RESISTANT CONSTRUCTION	NON-COMBUSTIBLE CONSTRUCTION	COMBUSTIBLE CONSTRUCTION
5'	15'	25'

ORGANIC AND/OR OTHER UNSUITABLE MATERIAL SHALL BE REMOVED FROM SUBGRADE AND BACKFILL AREAS AND BACKFILLED WITH ACCEPTABLE GRANULAR FILL, COMPACTED TO 95 % OF MAXIMUM DENSITY AT OPTIMUM MOISTURE CONTENT ASTM D1557 AND D2049. IF THE TOP THREE (3) FEET OF SUBGRADE BENEATH THE SLAB IS SUSCEPTIBLE TO A HIGH WATER TABLE OR PERIODIC SATURATION, THE EXISTING SOIL SHALL BE EXCAVATED AND BACKFILLED WITH A CLEAN ACCEPTABLE GRANULAR FILL AND THOROUGHLY COMPACTED TO 90% OF MAXIMUM DENSITY PER ASTM D2049 AND D1556.

SLAB TO BE MADE OF CONCRETE WITH A MINIMUM 28 DAY STRENGTH OF 4,000 PSI AND 6 % AIR CONTENT

TOP OF SLAB MUST BE SMOOTH, FLAT AND LEVEL.

NO WALLS TO BE BUILT AROUND OR CANOPIES ABOVE TRANSFORMER. PLACE TRANSFORMER AWAY FROM DOORS, WINDOWS, & BUILDING OPENINGS.\*

CUSTOMER TO FURNISH ALL MATERIAL, EXCEPT WHERE NOTED

ALL MATERIAL FURNISHED BY THE CUSTOMER SHALL EQUAL OR EXCEED THE STANDARDS AS SPECIFIED IN THE "NATIONAL ELECTRICAL CODE"

ALL CUSTOMER INSTALLED PRIMARY CONDUITS TO BE RODDED AND PROVEN CLEAR, AND A JET LINE TO BE LEFT IN EACH CONDUIT

ALL CONDUITS ENTERING SLAB TO BE VERTICAL AND AT A 90° ANGLE WITH TOP OF SLAB